



Korea Analysis Test Researcher (KATR)

Tongil-ro 140, A-336 (Samsung Techno Valley, Goyang City, Gyeonggi-do)
Tel : 1670 - 9936 | Fax : 02 - 6016 - 9711 | Email : katr@katr.re.kr

Test report

Request No. : KATRM200323-034 Request date : 2020. 03. 23
Report No. : KAAAM200408-013 Issue date : 2020. 04. 08
Company : Jinnys Co., Ltd Purpose of use : Quality control
Address : A-610, Cheonan mirae ace hightechcity, 10 Baekseokgongdan 1-ro, Seobuk-gu,
Cheonan-si, Chungcheongnam-do, Republic of Korea (ZIOCODE: 31094)
Person : Kim Sang Do
Submit company :
Name of sample : Acidic water using electrolysis of MEDIQUA / MEDI@CIDIC ionizer

Test item	Test result	
	Control	Sample
Guidelines for evaluating external disinfectant efficacy		
<i>Escherichia coli</i> ATCC 8739	Number of bacteria after 24 hr (CFU) Bacteria reduction rate (%)	7.6 X 10 ⁴ <10 99.9

※ Test method: *In vitro* method

※ Contact time: 24 hr

※ Bacterial reduction rate (%) = [(average CFU of control)-(average CFU of sample)]/(average CFU of control)X100


Korea Analysis Test Researcher




Remark: 1. This report is the result of test conducted by company's samples only. It does not guarantee the quality of all products.
2. This report cannot be used for advertisement, campaign, and legal purpose without KATR's permission. Do not use for any other purposes.

- Result picture -

ATCC 8739

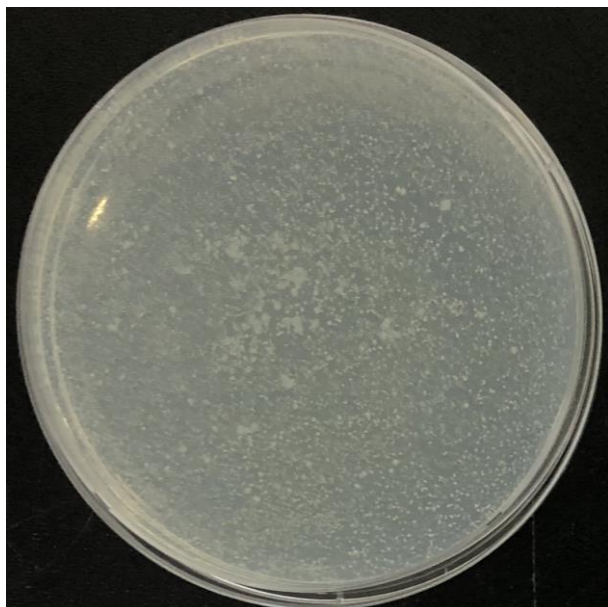

< Control >

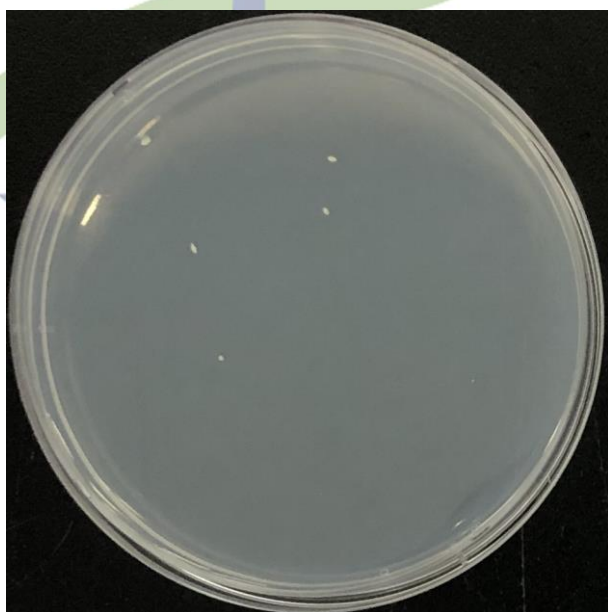

< Sample >

Remark: 1. This report is the result of test conducted by company's samples only. It does not guarantee the quality of all products.
2. This report cannot be used for advertisement, campaign, and legal purpose without KATR's permission. Do not use for any other purposes.

- Sample picture -



< Acidic water using electrolysis of MEDIQUA / MEDI@CIDIC ionizer>

Remark: 1. This report is the result of test conducted by company's samples only. It does not guarantee the quality of all products.
2. This report cannot be used for advertisement, campaign, and legal purpose without KATR's permission. Do not use for any other purposes.